


ACC Monitoring Agency

203 Armstrong Drive, Freeport, PA 16229, USA

<https://www.acc-ma.org>
412-365-1000



IVB Operationally Valid Candidate Data
Parameter: AVLI, Average Volume Loss (units=cu. mm)
Where validity is 'VI' or 'VQ'

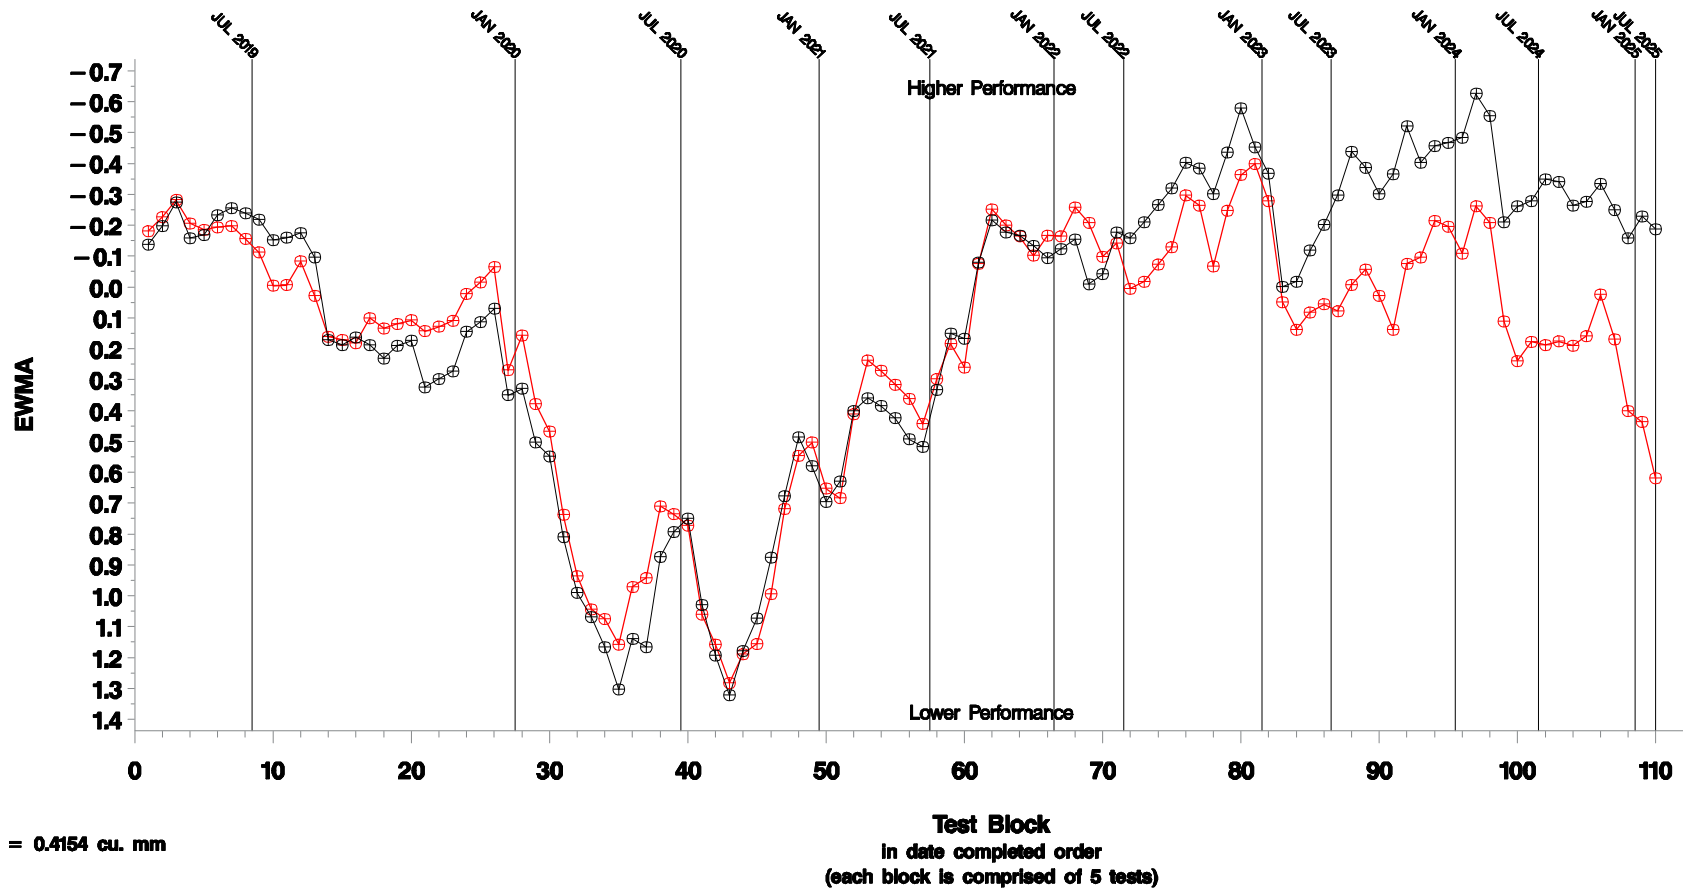

ACC Monitoring Agency

203 Armstrong Drive, Freeport, PA 16229, USA

<https://www.acc-ma.org>
412-365-1000

Services provided by:




A Program of ASTM International

IVB Operationally Valid Candidate Data

Parameter: FE, EOT Iron (units=mg/kg)

Where validity is 'VI' or 'VQ'

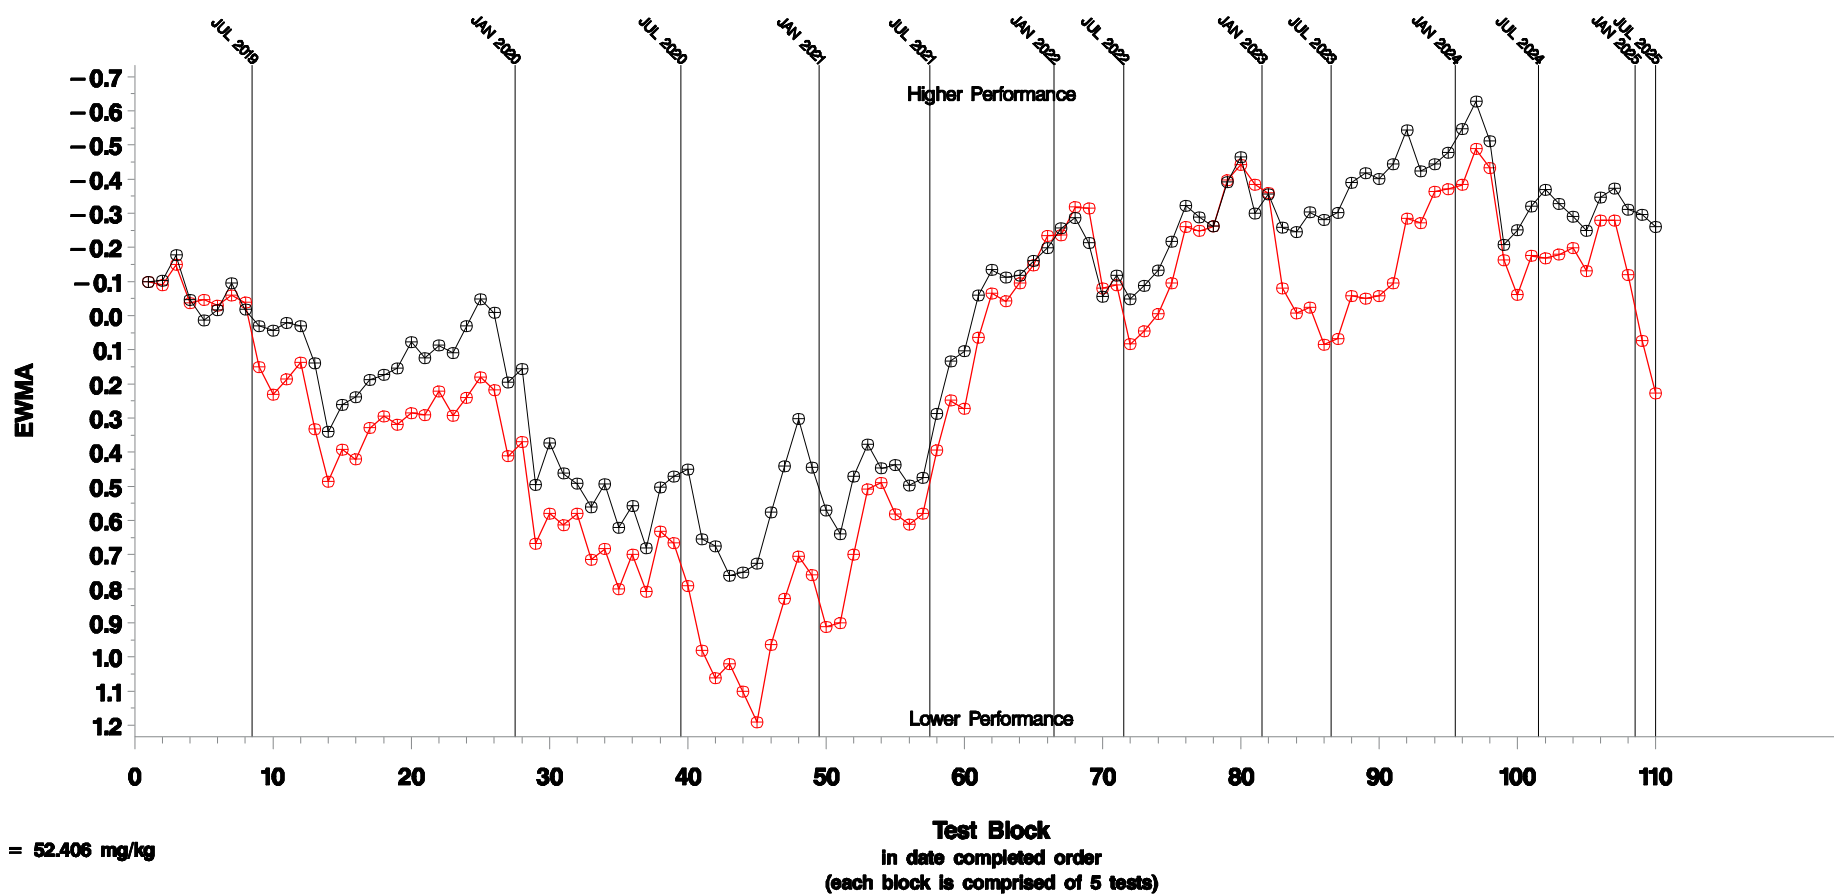

⊕⊕⊕ with SA
⊕⊕⊕ without SA