

Status Of Reported Tests

STATUS	COUNT	PERCENT
Cancelled	1	5.263
Valid	18	94.737
Total Reported Tests	19	100.000

Itemized Lost Test Report

Obs	Date	TESTKEY	REASON
1	20211101	ACC-31171	Test Terminated At Sponsor Request

Replicate Database Report

Components of Replicate Database	APR 2022	All Periods
Number of Tests	1	10
Formulations	1	5
Labs	1	3
Stands	1	8

by-Formulation Pooled s and Reproducibility of Replicate Data

Report Period	Parameter	Degrees of Freedom	Pooled s	R
APR 2022	IRPH360	0	0.0000	0.0000
APR 2022	KV40PC	0	0.0000	0.0000
APR 2022	IRPH360 (Without SA)	0	0.0000	0.0000
APR 2022	KV40PC (Without SA)	0	0.0000	0.0000
All	IRPH360	5	28.6910	80.3347
All	KV40PC	5	25.9381	72.6266
All	IRPH360 (Without SA)	5	27.3862	76.6813
All	KV40PC (Without SA)	5	20.6900	57.9320

Pass/Fail
 IRPH360 <=125 KV40PC <=75

Report Period	API Category	N	Number Passed	% Passed
APR 2022	All Categories, All Parameters	18	17	94.444
APR 2022	CK - All Parameters	18	17	94.444
APR 2022	CK, IRPH360	18	17	94.444
APR 2022	CK, IRPH360 (Without SA)	18	17	94.444
APR 2022	CK, KV40PC	18	17	94.444
APR 2022	CK, KV40PC (Without SA)	18	18	100.000
All	All Categories, All Parameters	376	296	78.723
All	CK - All Parameters	376	296	78.723
All	CK, IRPH360	376	308	81.915
All	CK, IRPH360 (Without SA)	376	327	86.968
All	CK, KV40PC	376	319	84.840
All	CK, KV40PC (Without SA)	376	346	92.021




Monitoring Agency

6555 Penn Avenue, Pittsburgh, PA 15206

<https://acc-ma.org>

T13

Status of Reported Tests

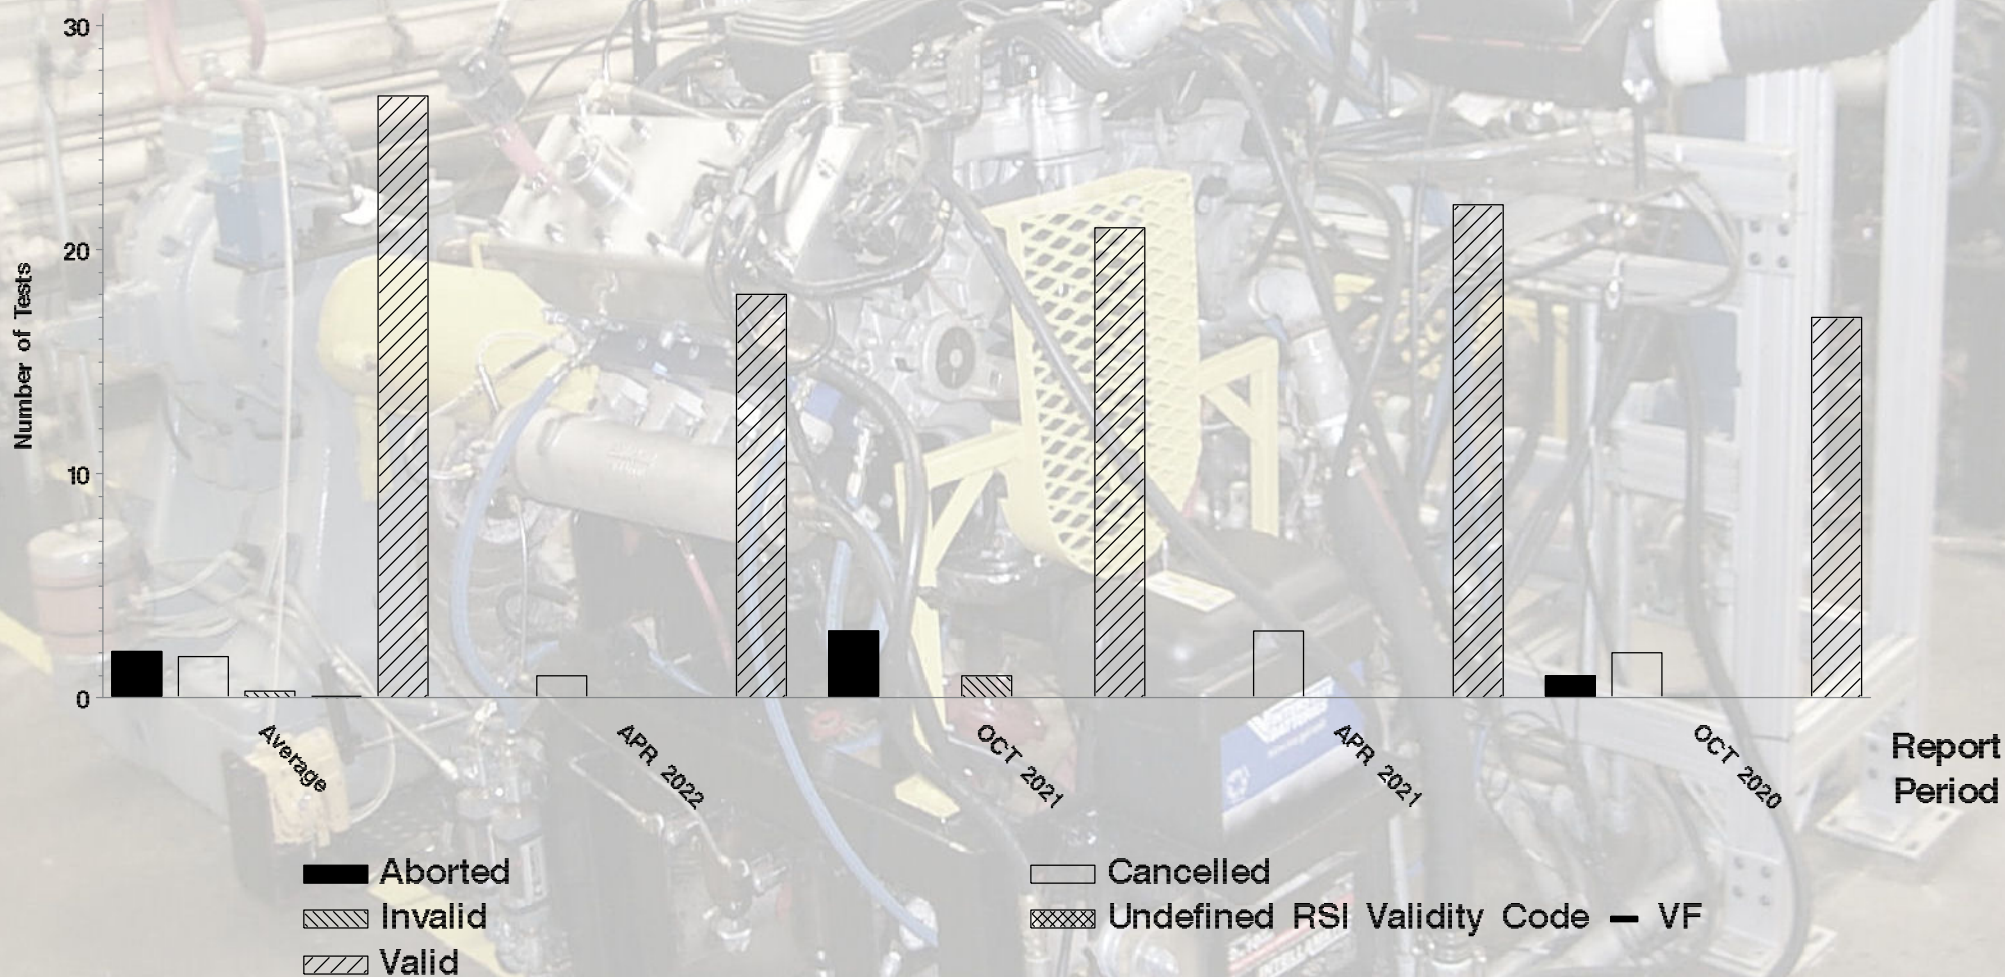




Monitoring Agency

6555 Penn Avenue, Pittsburgh, PA 15206

<https://acc-ma.org>

T13

Candidate Precision as Represented by Pooled S

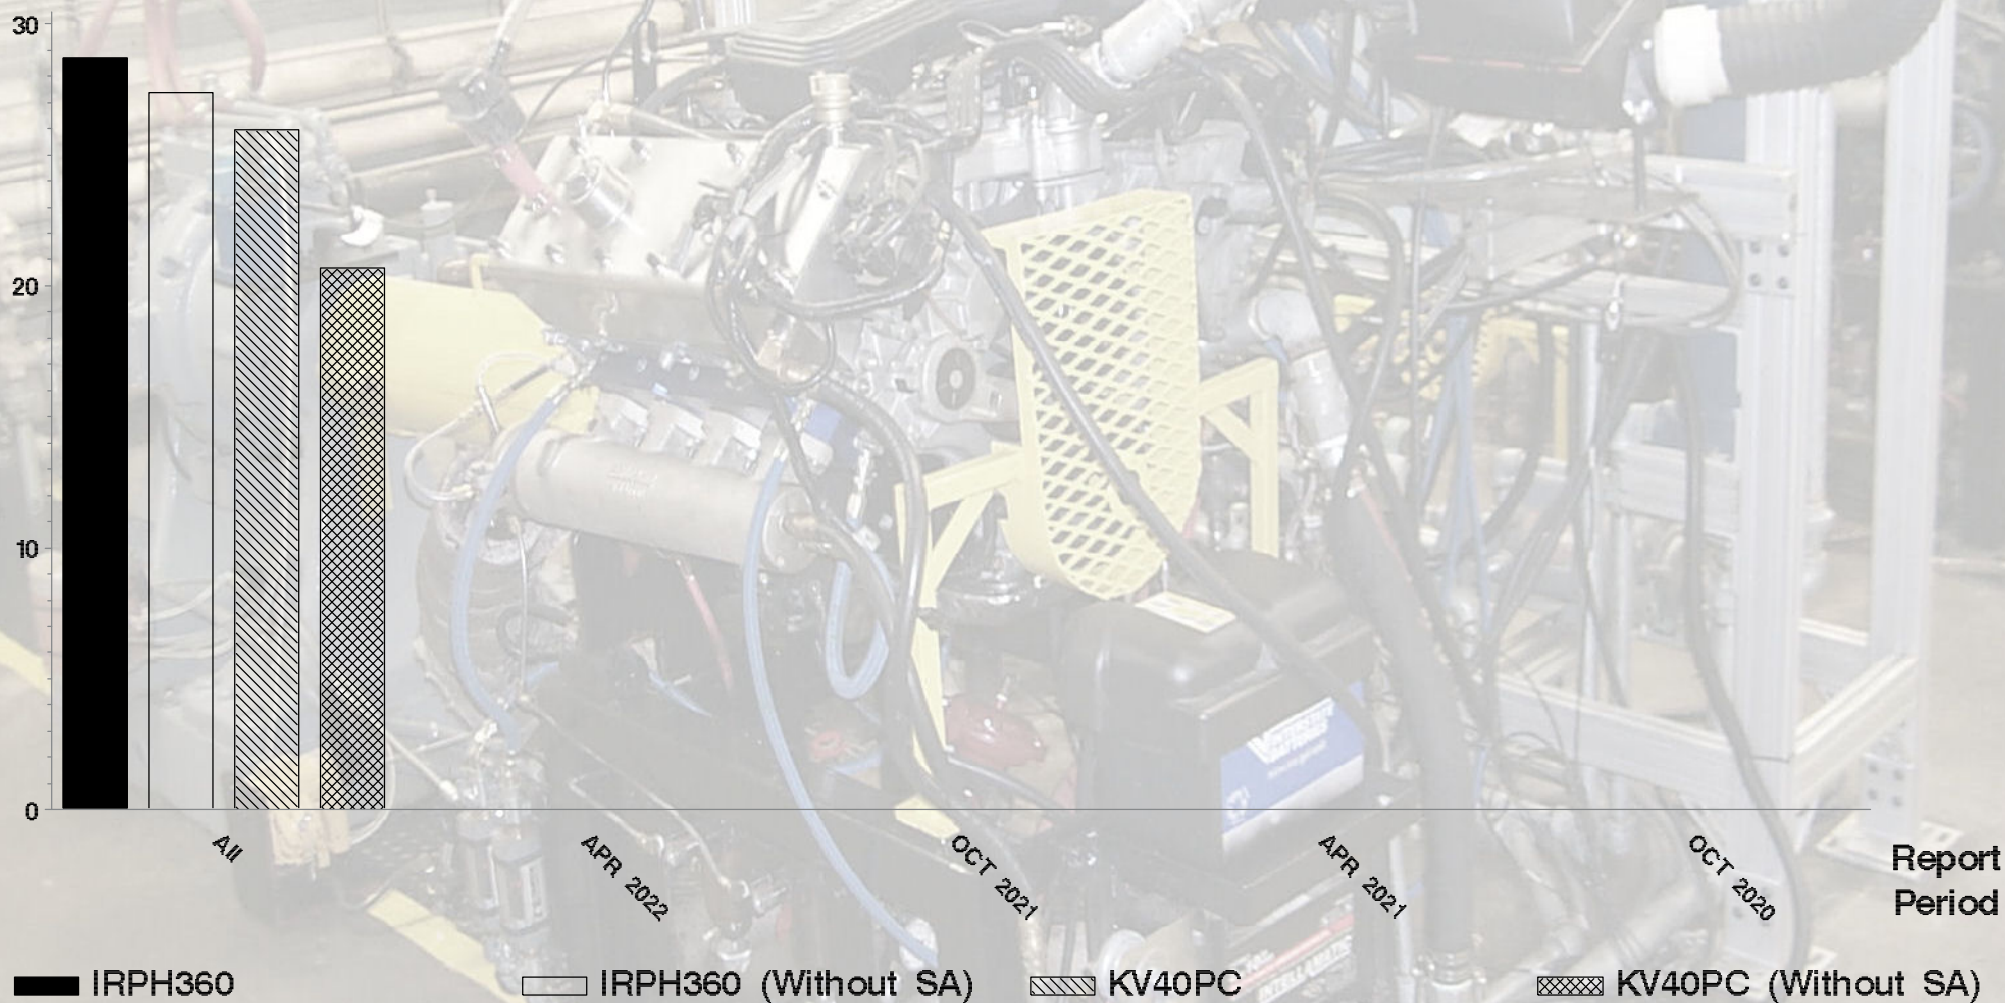

Monday, April 11, 2022